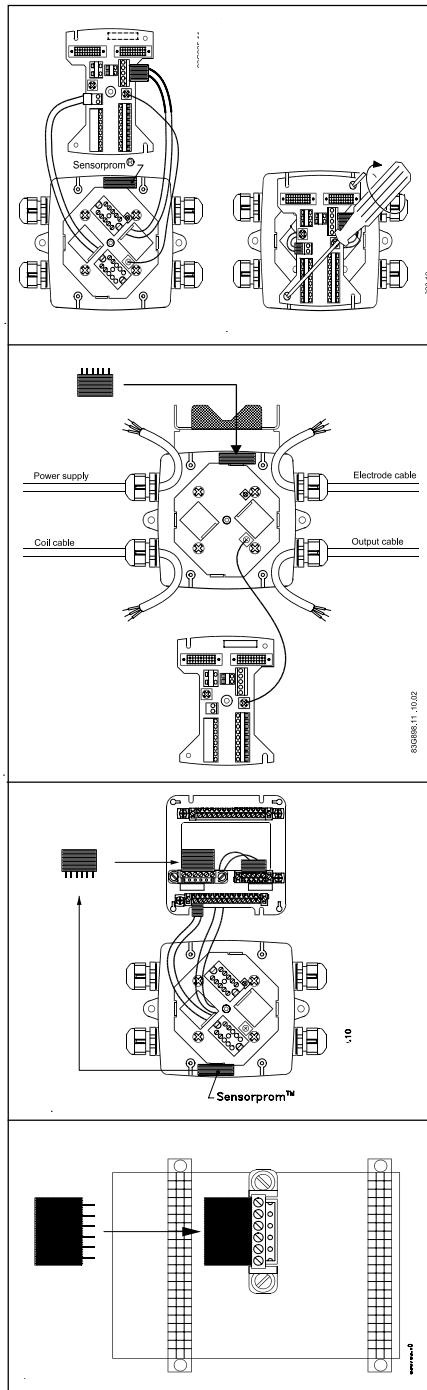


**English**

**SITRANS F M MAGFLO®**  
**Electromagnetic flowmeter**  
**2 kB SENSORPROM® memory unit**

The enclosed SENSORPROM® memory unit (2 kB) must be used with transmitters type MAG 5000, MAG 6000 or MAG 2500 and MAG 3000 manufactured week 47/1997 or later.

Transmitters type MAG 2500 and MAG 3000 manufactured before week 47/1997 require another type of SENSORPROM® memory unit

**Standard compact installation**

The SENSORPROM® memory unit is as standard delivered mounted in the terminal box of the sensor. The connections to the transmitter are made when the connection plate is located in the terminal box.

**Remote installation**

When a wall mounting unit is used for remote installation, the SENSORPROM® unit must be removed from the sensor and installed at the bottom of the connection plate or, if possible, directly in the wall mounting unit.

**MAG 2500 and MAG 3000 Compact**  
**The SENSORPROM® unit must be installed as shown below.****MAG 5000, MAG 6000, MAG 2500 and MAG 3000 19" insert version**  
**The SENSORPROM® unit must be installed as shown below.**