


HC900 Boiler Control Industry: Manufacturing

Application Brief

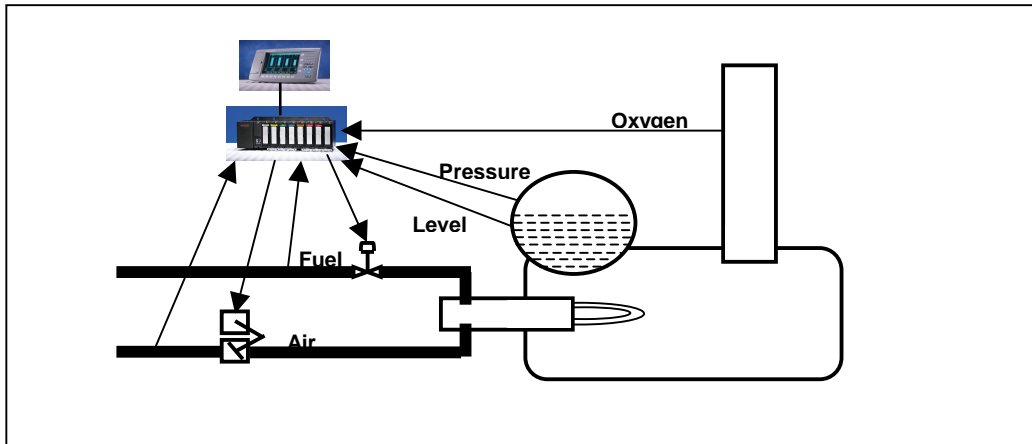

Background

Until recent years, only the largest boilers could justify sophisticated boiler controls. Now high fuel costs and occasional limited fuel availability make it necessary to improve boiler efficiency and minimize costly steam losses and disturbances.

Government regulations force compliance with air pollution and safety standards. Combustion controls have also become more important because boiler loads are being varied to meet needs rather than operating at full capacity and wasting fuel and steam.

Similar concerns are causing the metals processing and heat treating industries to improve control for their furnaces and other fuel fired processes.

Solution

Modern controls such as the HC900 Hybrid Controller can provide the most efficient boiler operation.

Drum Level Control. The steam drum is an integral part of a boiler. The vessel's primary function is to provide a surface area and volume near the top of the boiler where separation of steam from water can occur. It also provides a location for chemical water treatment, addition of feedwater, recirculation water, and blowdown.

Blowdown removes residue and maintains a specified impurity level to reduce scale formation. Because these functions involve the continual addition and loss of material, the water-steam interface level is critical. Low level affects the recirculation of water to the boiler tubes and reduces the water treatment effectiveness. High level reduces the surface area and can lead to water and dissolved solids entering the steam distribution system.

The objective of the drum level control system is to maintain the water-steam interface at the specified level and provide a continuous mass balance by replacing every pound of steam with a pound of feedwater.

Types of Drum Level Control. There are 3 basic types of drum level control systems: single element, two element and three element. Their application depends upon specific boiler size and load changes.

The **Single Element System** is the simplest approach. It measures level and regulates feedwater flow to maintain the level. This is only effective for smaller boilers supplying steady processes which have slow and moderate load changes.

The **Two Element System** uses two variables, drum level and steam flow to manipulate the feedwater flow. Steam flow load changes are fed forward to the feedwater valve providing an initial correction for load changes. The steam flow range and feedwater flow range are matched so that a one pound change in steam flow results in a one pound change in feedwater flow. This system is adequate for load changes of moderate speed and magnitude and can be applied to any size boiler. It does have two drawbacks. It cannot adjust for pressure or load disturbances in the feedwater system and cannot adjust for phasing interaction in the process because only the relatively slow responding drum level is controlled.

The **Three Element System** adds a third variable, feedwater flow rate to manipulate the feedwater control valve. This system provides close control during transient conditions because the two controllers minimize phasing interaction present in the two element approach. The feedwater control assures an immediate correction for feedwater disturbances. The drum level control provides trimming action. This system can handle large and rapid load changes and feedwater disturbances regardless of boiler capacity. This approach is required on multiple boilers having a common feedwater supply. It is ideal for plants with both batch and continuous processes where sudden and unpredictable steam demand changes are common.

Fuel-Air Ratio Control. A fuel-air metering control system is essential for efficient combustion in boilers, furnaces, and other large fuel fired heating processes. There are 3 basic types of Fuel-Air Ratio control systems: series metered system, parallel metered system, and cross limiting system.

HC900 Boiler Control

The **Series Metered System** is fairly common where load changes are not large or common. Both fuel and air are metered. The steam pressure controller regulates the fuel flow which is measured, linearized and then is ratioed and used as the remote set point to the air flow controller. This positions an air damper to maintain the specified ratio between the fuel and air.

This system is adequate for near steady state conditions. However lags in response to load changes can result in temporary smoking, incomplete combustion and fuel-rich conditions.

The **Parallel Metered System** operates the fuel and air control controllers in parallel from a setpoint generated by the steam pressure controller. The setpoint signal is ratioed before being used as the setpoint to the air controller to establish the fuel-air proportions. This system relies on similar responses from both controllers to prevent improper fuel-air mixtures. This system is best applied to processes that experience relatively slow load changes.

The **Cross Limiting System** is used when large or frequent load changes are expected. This is a dynamic system which helps compensate for the different speed of response of the fuel valve and air damper. It prevents a "fuel-rich" condition and minimizes smoking and air pollution from the stack.

The system is also known as a *lead-lag* system. When demand increases, a low selector blocks then increase forcing the air flow signal to become the setpoint to the fuel flow controller. A high selector passes the increase to the airflow controller's setpoint. This means fuel flow can not increase until air flow has begun to increase, i.e. **air increase leads fuel increase**.

When demand decreases, the low selector passes the signal to the fuel flow controller setpoint: while the high selector passes the fuel flow signal to the air flow controller setpoint. This means flow can not decrease until the fuel flow begins to drop hence **air decrease lags fuel decrease**. This means a fuel rich condition is avoided, regardless of the direction of load change.

Oxygen Trim. Automatic oxygen trim of the fuel-air ratio is used to reduce excess air and thereby excess oxygen to nearly stoichiometric combustion efficiency.

Too much air results in energy lost up the stack. Insufficient air results in loss of heat generation and increased pollution due to incomplete fuel combustion.

A certain amount of excess air is required to insure that complete combustion occurs within the combustion chamber and to compensate for delays in fuel-air ratio control action during load changes.

In addition to improved efficiency lower excess air helps reduce corrosion and air pollution by minimizing formation undesired gases.


Benefit Summary

The Honeywell HC900 provides the following benefits when used in boiler control applications:

- Integrated loop and logic control minimizes equipment cost
- The robust function block set allows sophisticated control plus on-line process trim adjustments during periodic maintenance.
- Integrated control and operator interface simplifies setup
- The ability to trend and log process data for regulatory agency reporting
- A common configuration tool for both control and Operator Interface minimizing engineering costs.
- Open Ethernet connectivity for central supervision

Implementation

Overview. The HC900 Hybrid Controller consists of a panel-mounted controller, available in 3 rack sizes along with remote I/O, connected to a dedicated Operator Interface (OI).

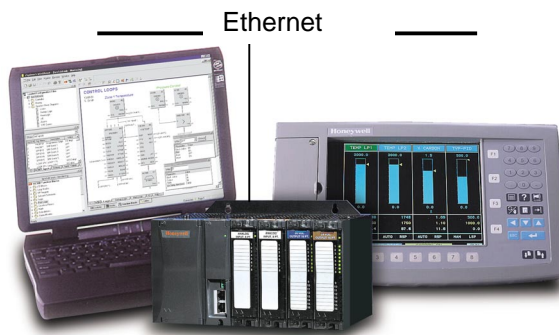

HC900 Hybrid Controller, Model 1042 OI and Hybrid Control Designer Software

All field signals terminate at the controller. The controller has universal analog inputs, analog outputs and a wide variety of digital input and output types. This controller will provide all the boiler control functions.

Configuration. The Hybrid Control Designer tool provides advanced configuration techniques allow a variety of strategies to be easily implemented. The run-mode configuration monitoring and editing capability allows these strategies to be tested and refined, while minimizing upsets, as process knowledge is gained.

Monitoring. The complete operation can be monitored and controlled from the easy to use, familiar displays of the Model 1042 OI.

Data Storage. The data storage feature of the OI can be used to log process information during the cycle to an integral floppy disk for a permanent record.

Open Connectivity Over Ethernet. Use popular HMI, data acquisition, OPC server, and HC900's HC Designer configuration software over an Ethernet LAN concurrently to access HC900 controllers.